


CURRENT IN AMPERES

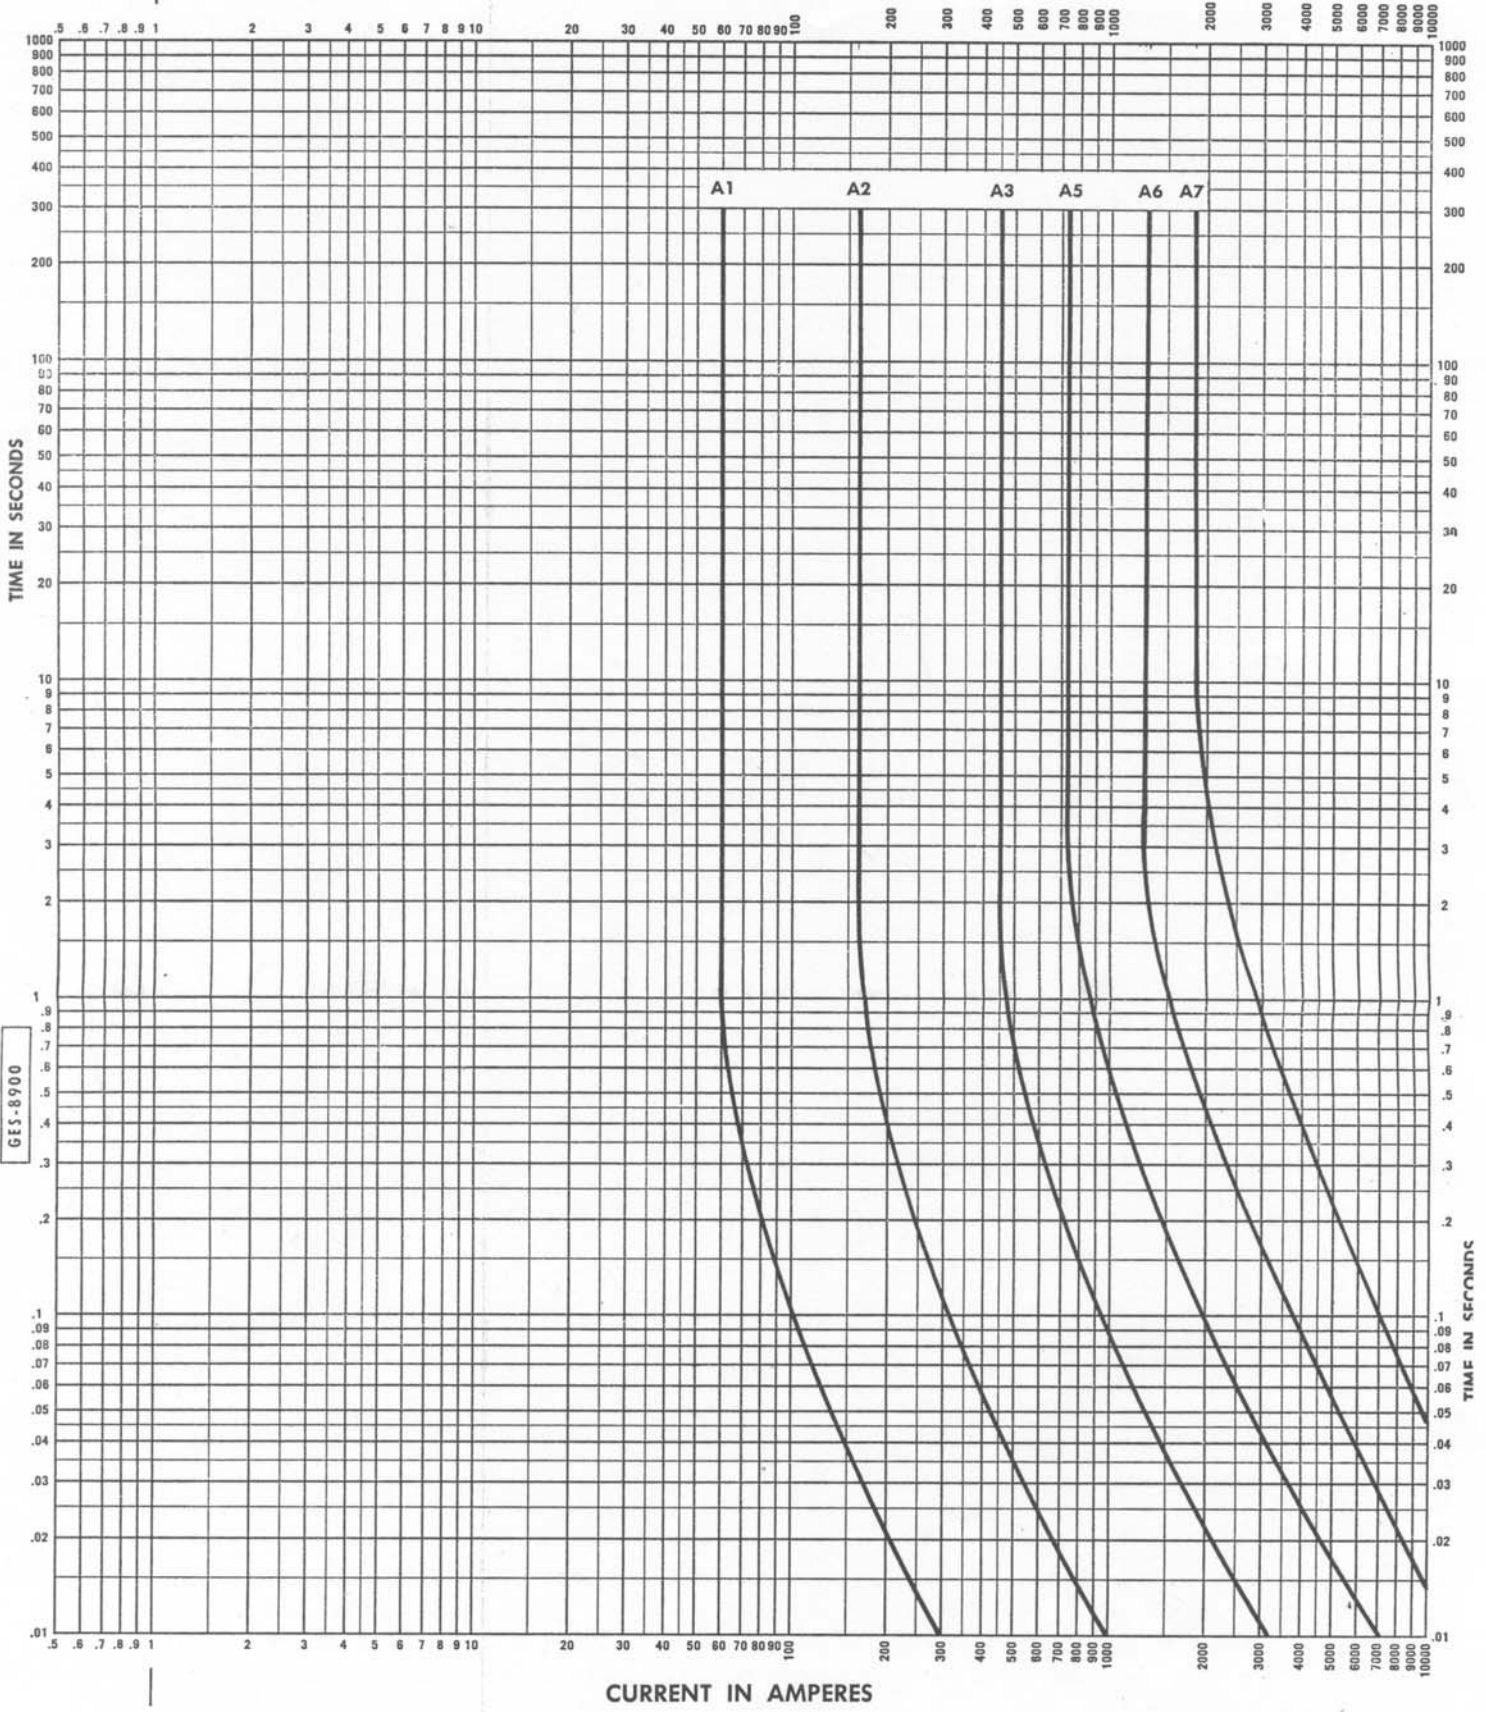

TIME IN SECONDS

GES-8900

TIME IN SECONDS

CURRENT IN AMPERES



Current Ratings
Limits as Indicated

ISOLATION FUSE LINK

GES - 8900

2561K011 G01 TO G07 INCL.

MINIMUM MELTING TIME-CURRENT CURVES

(TESTS MADE AT 60 HZ AND LOW VOLTAGE, AC, STARTING AT 25 C AMBIENT IN TRANSFORMER OIL WITH NO INITIAL LOAD)