


CURRENT IN AMPERES



CURRENT IN AMPERES

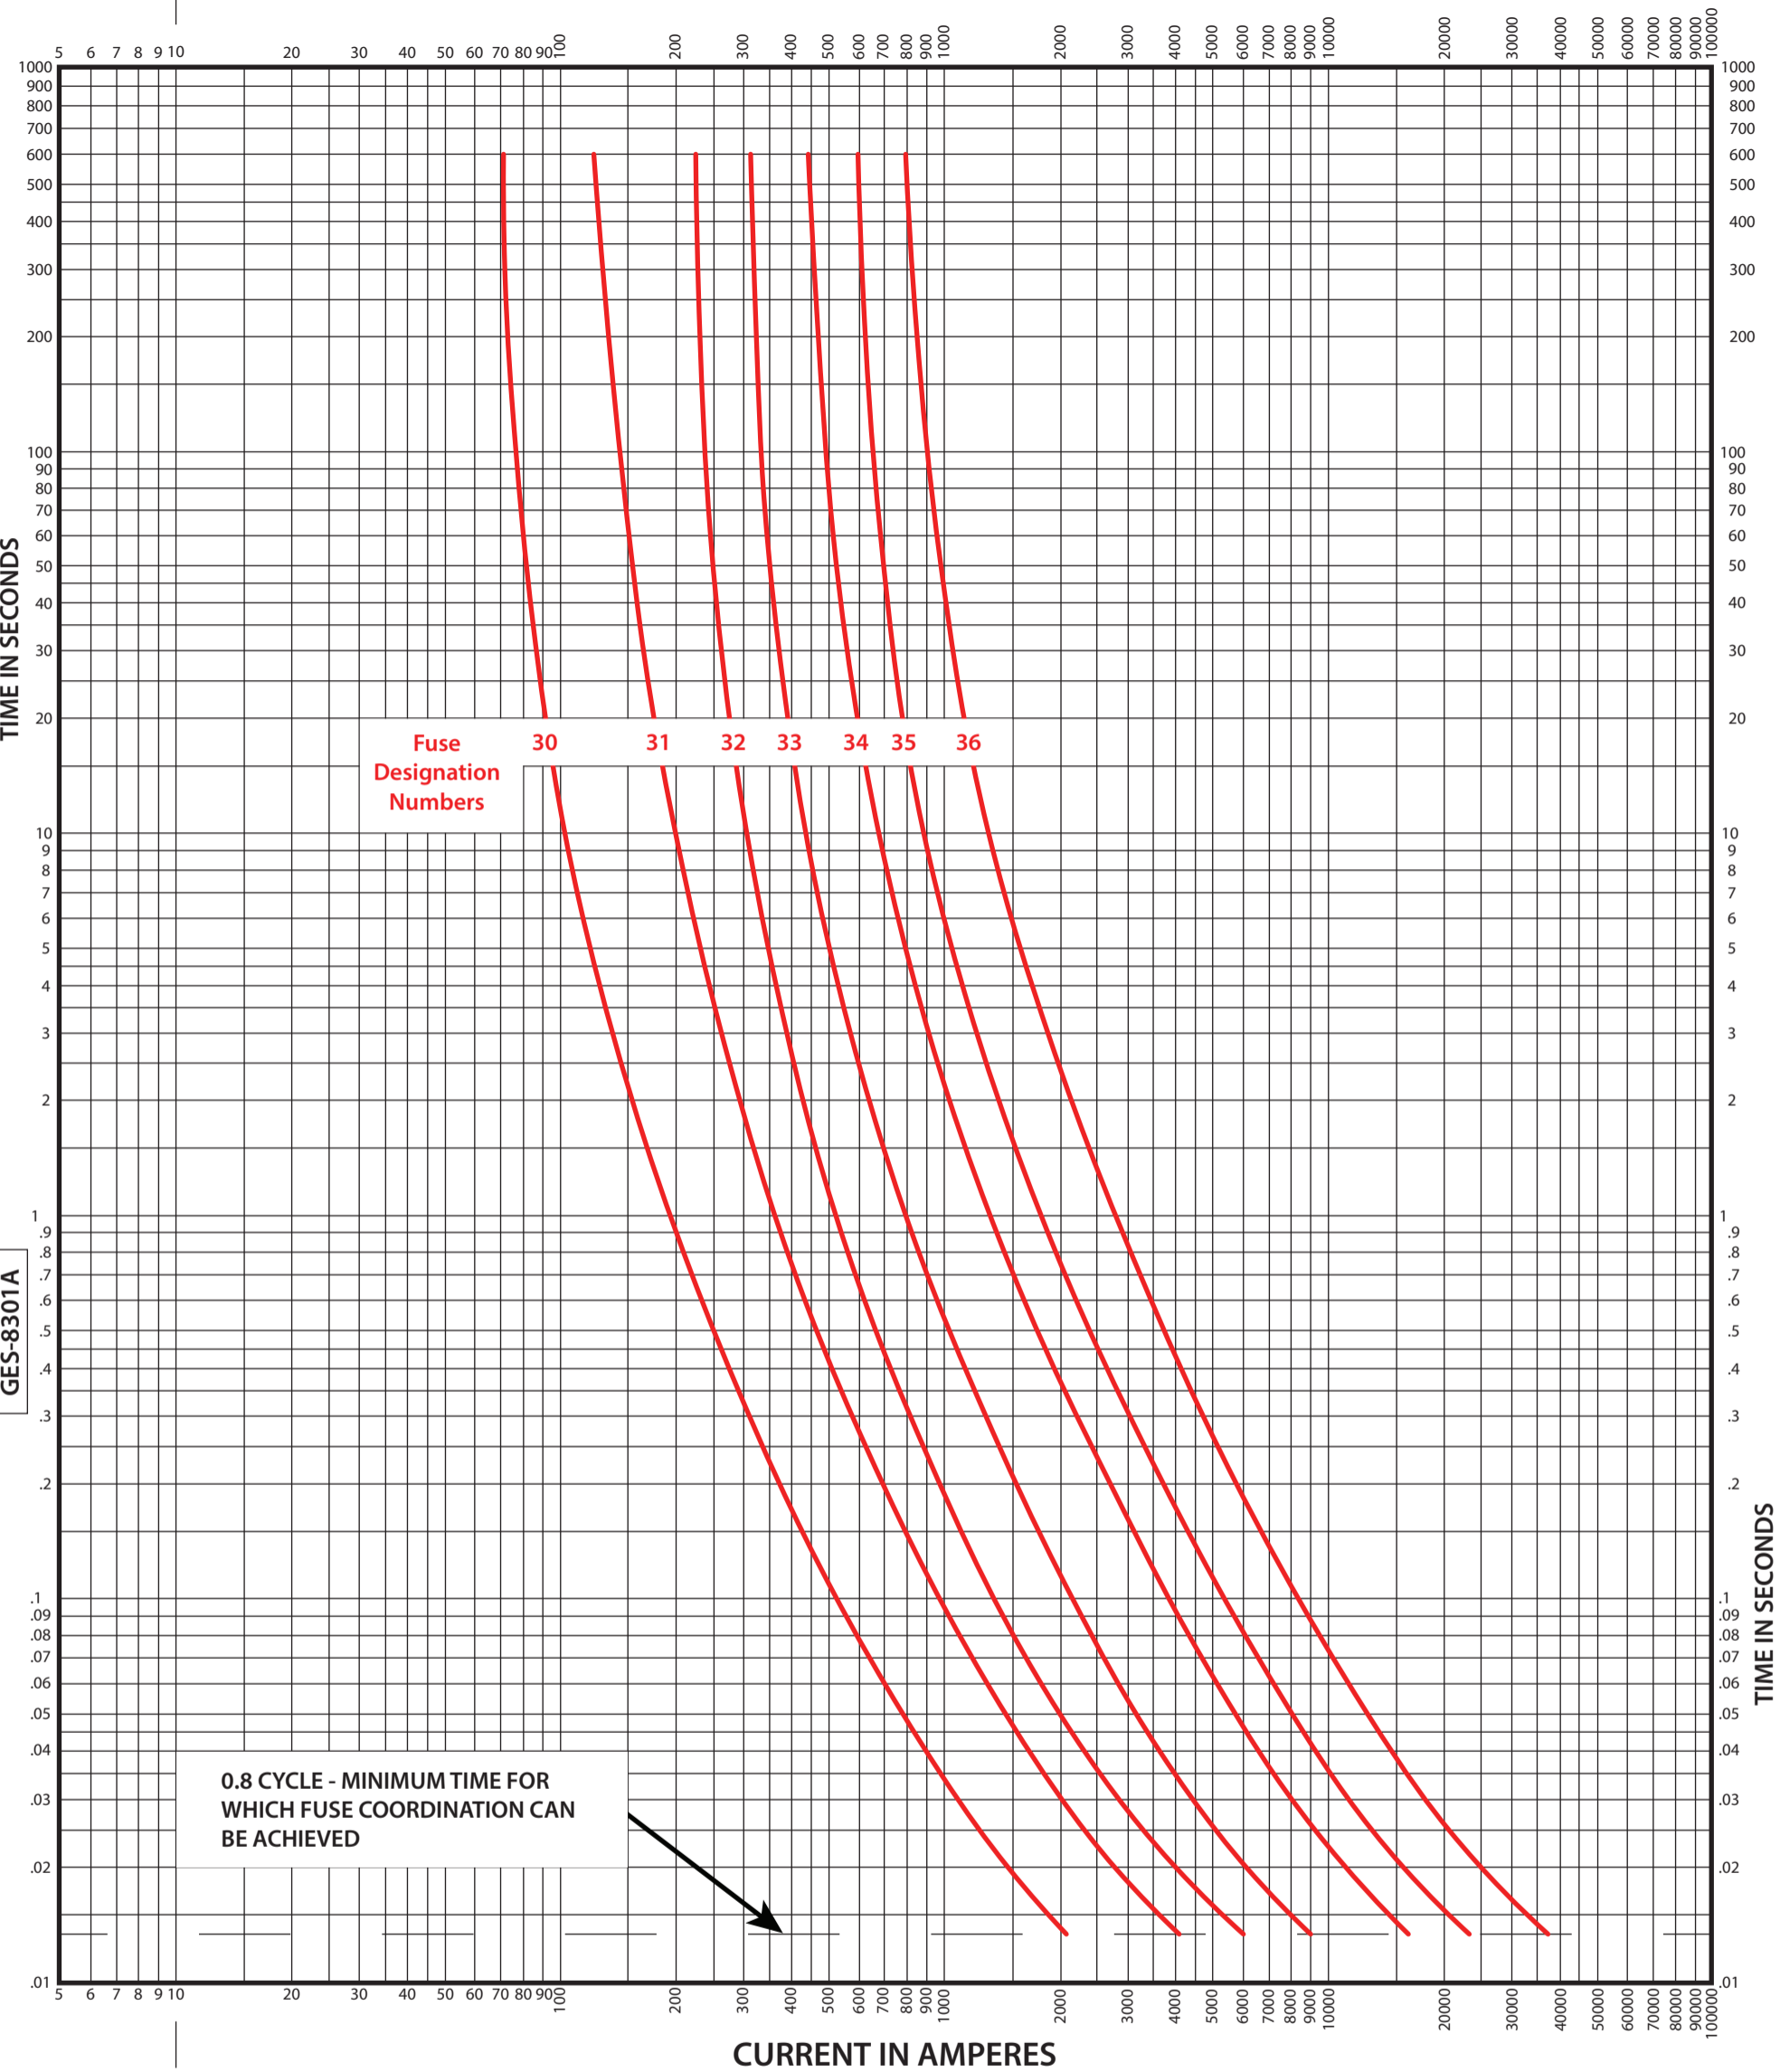

DISTRIBUTION TRANSFORMER INTERNAL FUSES
9F54WLD SERIES 15 KV MAX

GES-8301A

FUSE NUMBERS 30 TO 36

Maximum Total-clearing Time-current Curves

(AT 60 HZ AND 25 C AMBIENT WITH NO INITIAL LOAD)

Current ratings are not assigned to distribution transformer internal fuses.