



CURRENT IN AMPERES

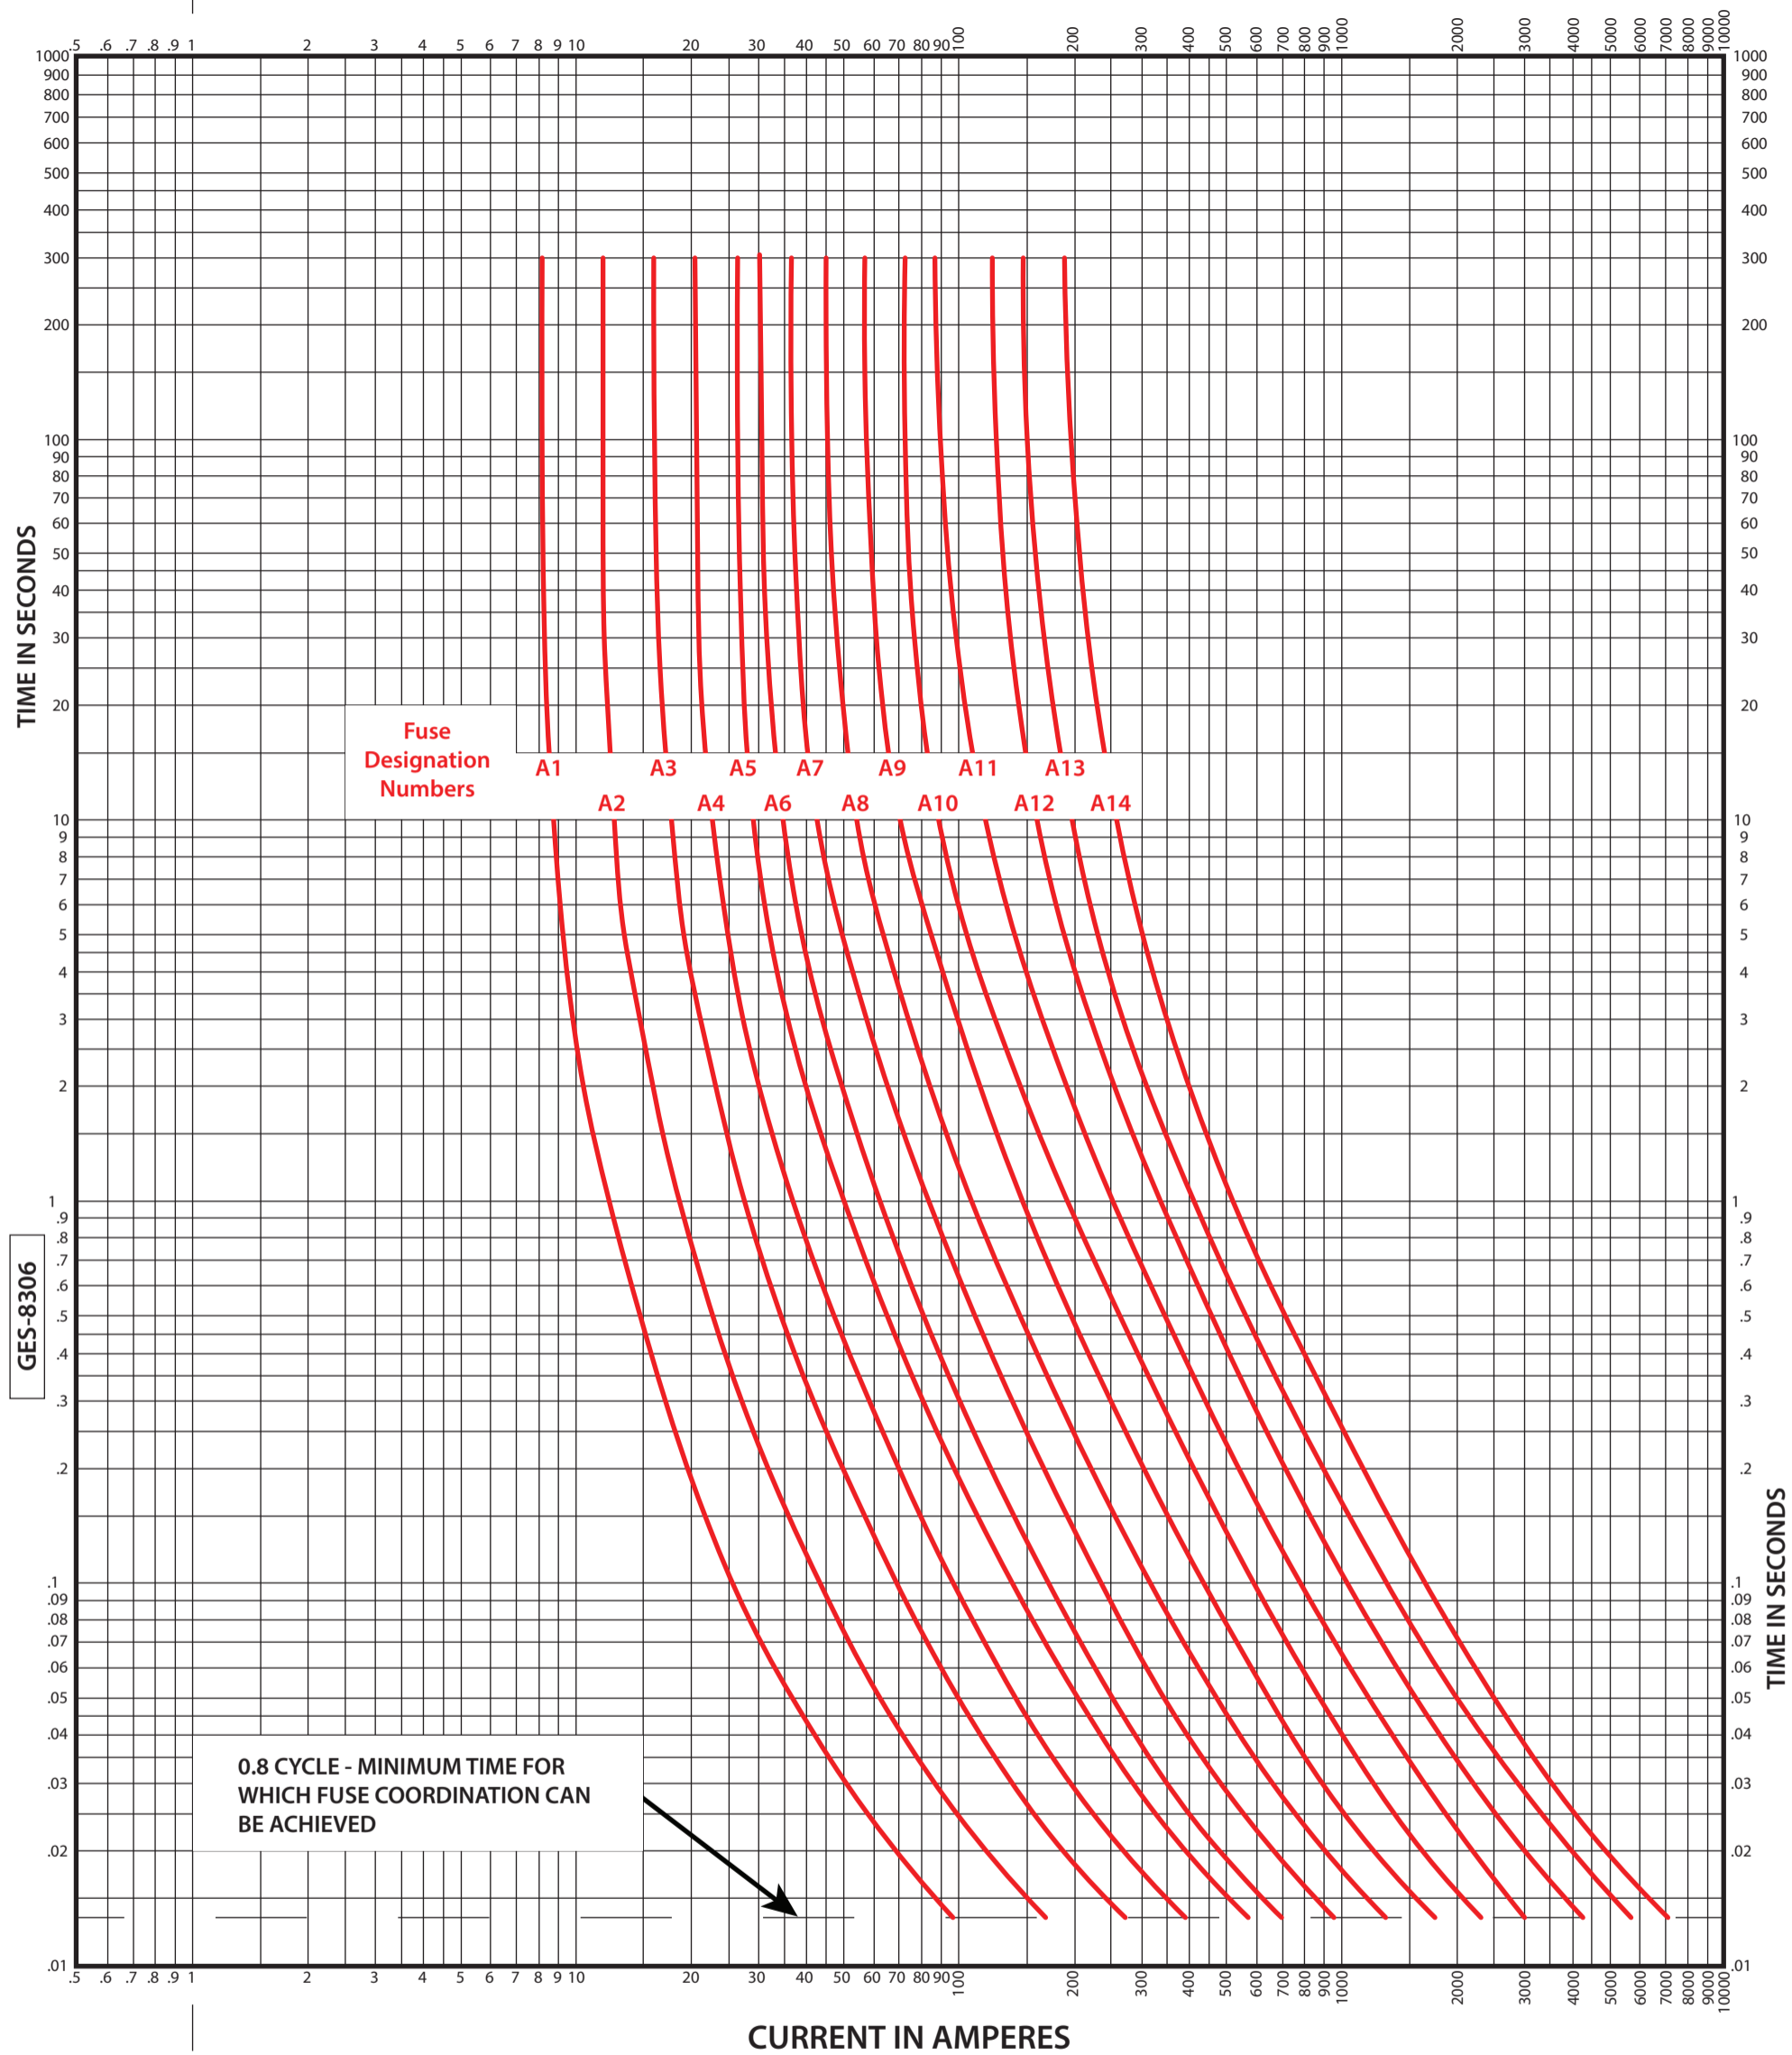

Fuse Designation Numbers

A1 A2 A3 A4 A5 A6 A7 A8 A9 A10 A11 A12 A13 A14

0.8 CYCLE - MINIMUM TIME FOR WHICH FUSE COORDINATION CAN BE ACHIEVED



CURRENT IN AMPERES



CONNECTION BOARD FUSES
 9F54DA SERIES 5.2 KV MAX
 9F54EA SERIES 5.2 KV MAX
 9F54GA SERIES 5.2 KV MAX
 FUSE NUMBERS A1 TO A14
 Maximum Total-clearing Time-current Curves
 (AT 60 HZ AND 25 C AMBIENT WITH NO INITIAL LOAD)

GES-8306

Current ratings are not assigned to distribution transformer internal fuses.