


TRANSFORMER BUSHING FUSES
9F54VB SERIES 8.4 KV MAX
9F54VC SERIES 15.0 KV MAX
9F54VD SERIES

GES-8314B

Current ratings are not assigned to distribution transformer internal fuses.

FUSE NUMBERS V1 TO V14
Minimum Melting Time-current Curves

(At 60 Hertz and 25 C ambient with no initial load)

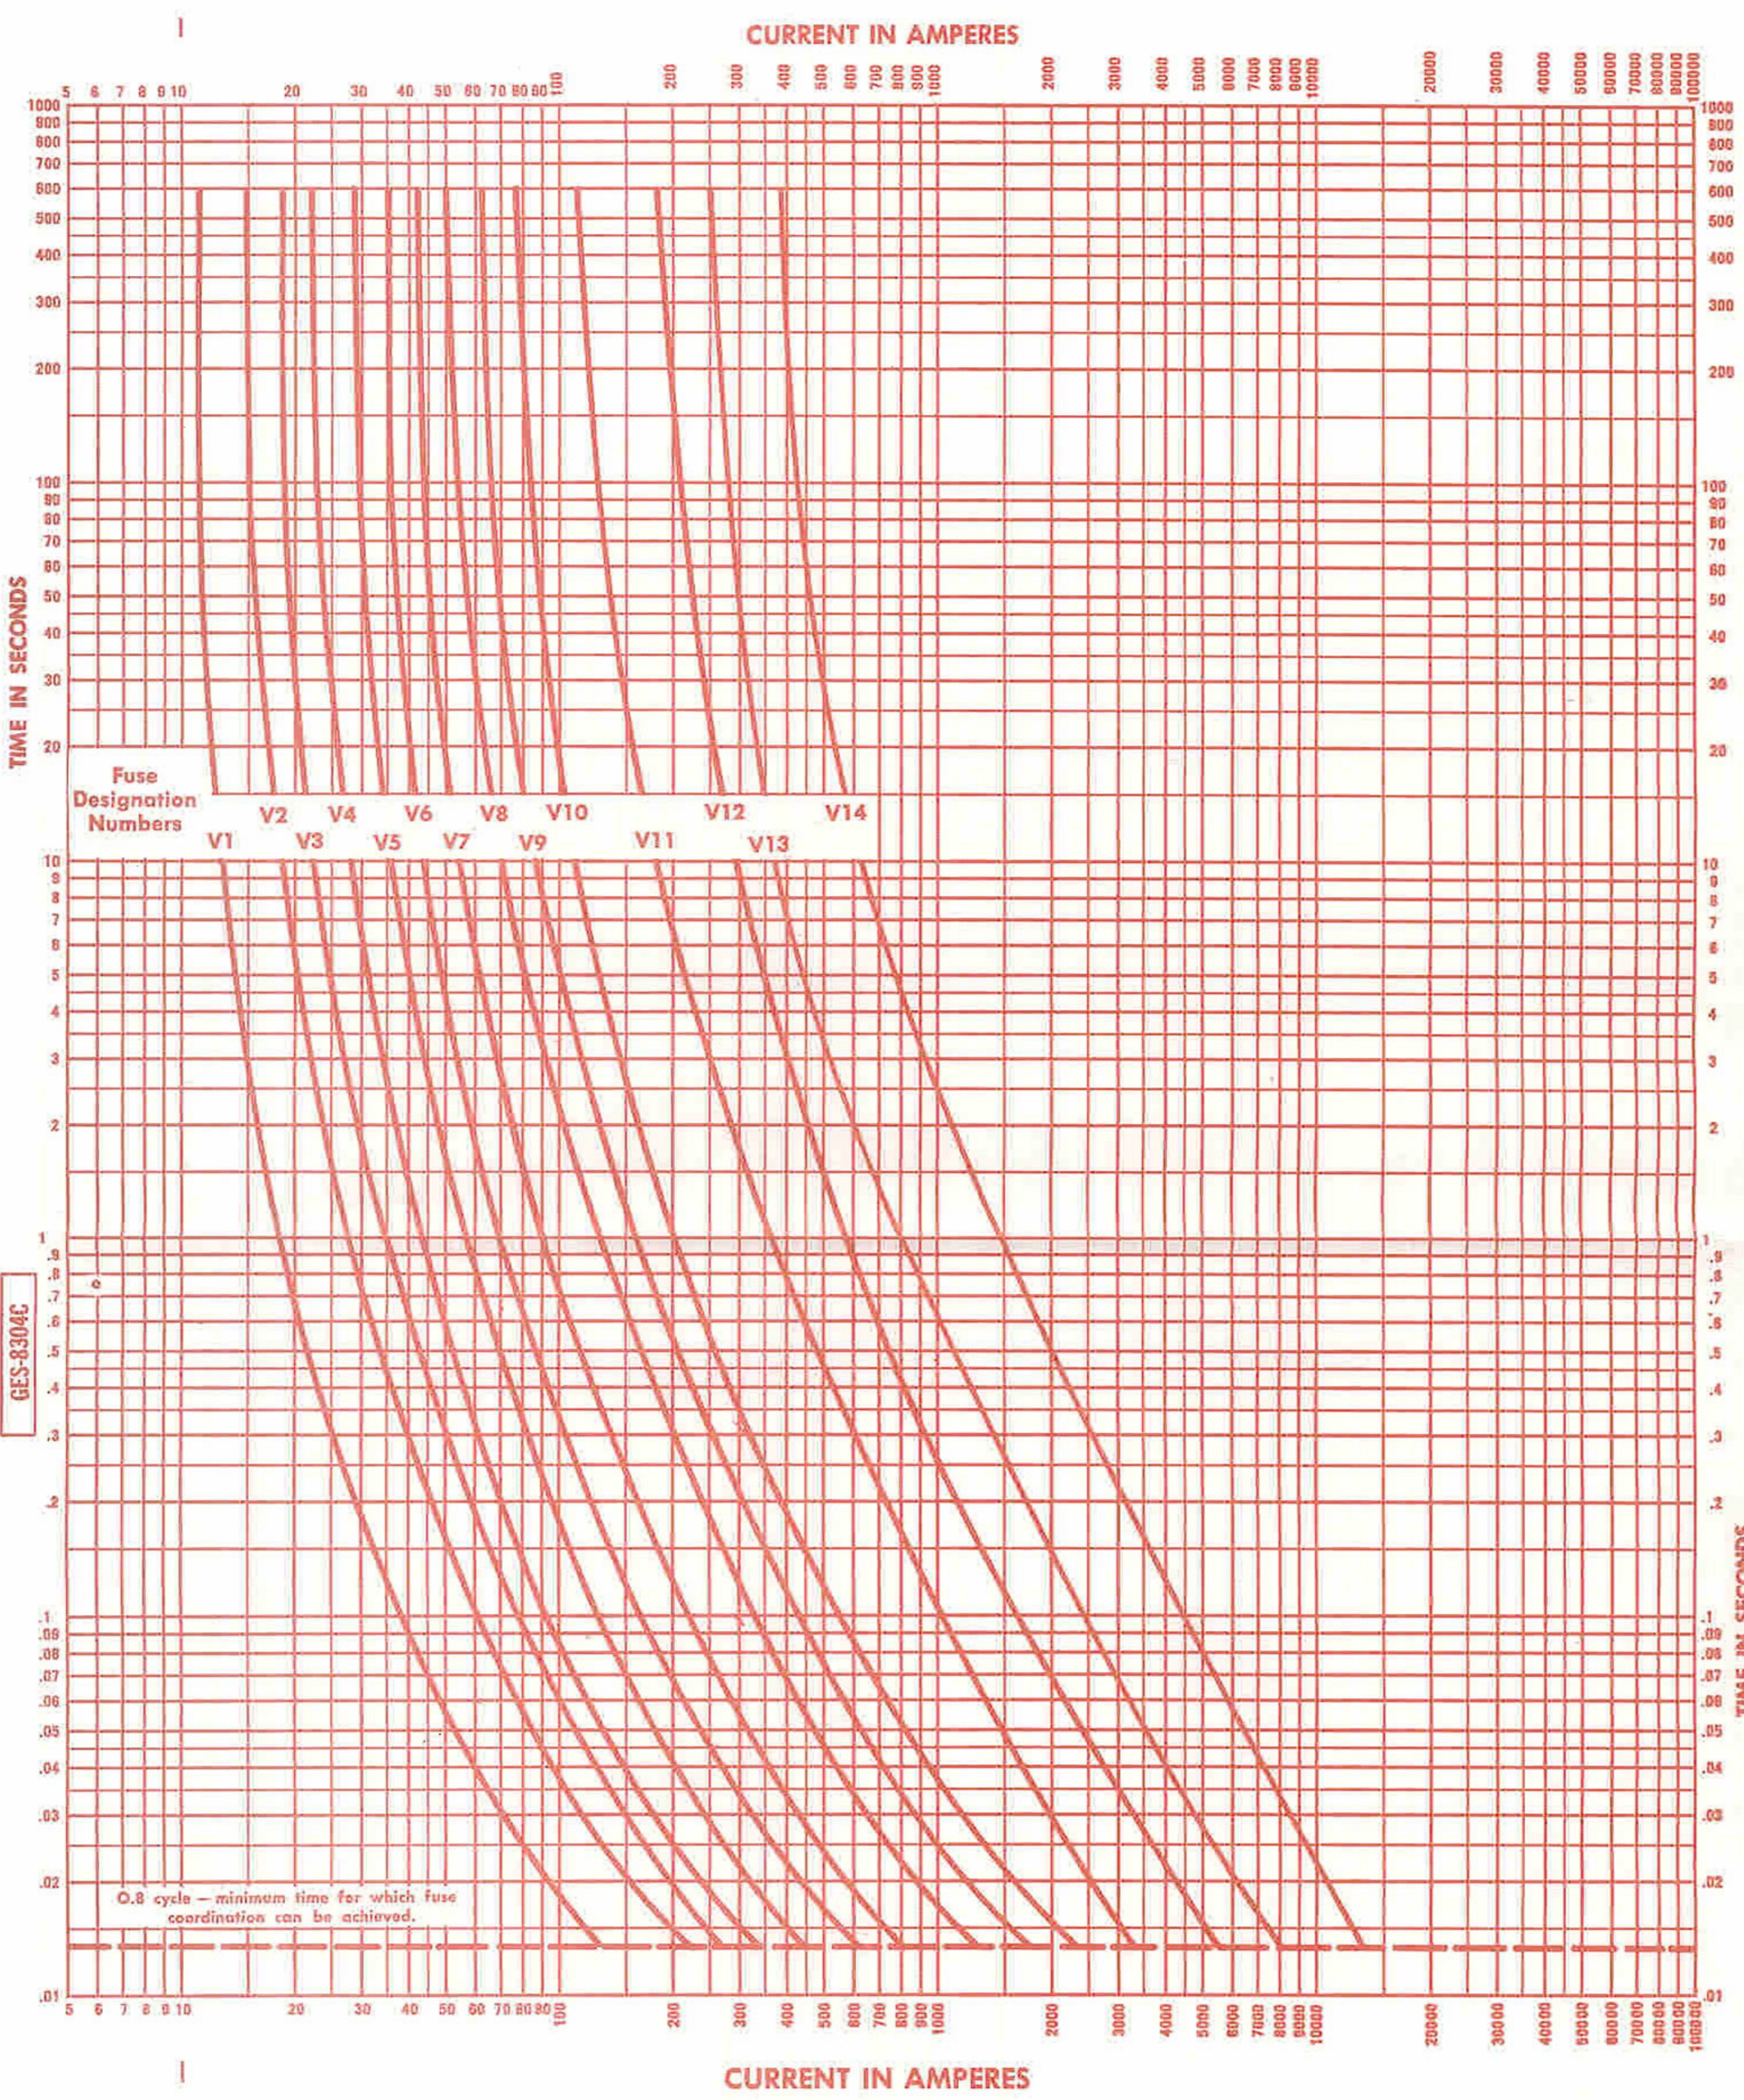

CURRENT IN AMPERES

TIME IN SECONDS

TIME IN SECONDS

CURRENT IN AMPERES

TIME IN SECONDS

0.8 cycle - minimum time for which fuse coordination can be achieved.



ERMCO COMPONENTS, INC.

Current ratings are not assigned to distribution transformer internal fuses.

TRANSFORMER BUSHING FUSES
9F54VB SERIES 8.4 KV MAX
9F54VC SERIES 15.0 KV MAX
9F54VD SERIES

FUSE NUMBERS V1 TO V14
Maximum Total-clearing Time-current Curves

(At 60 Hertz and 25 C ambient with no initial load)

GES-8304C