


CURRENT IN AMPERES

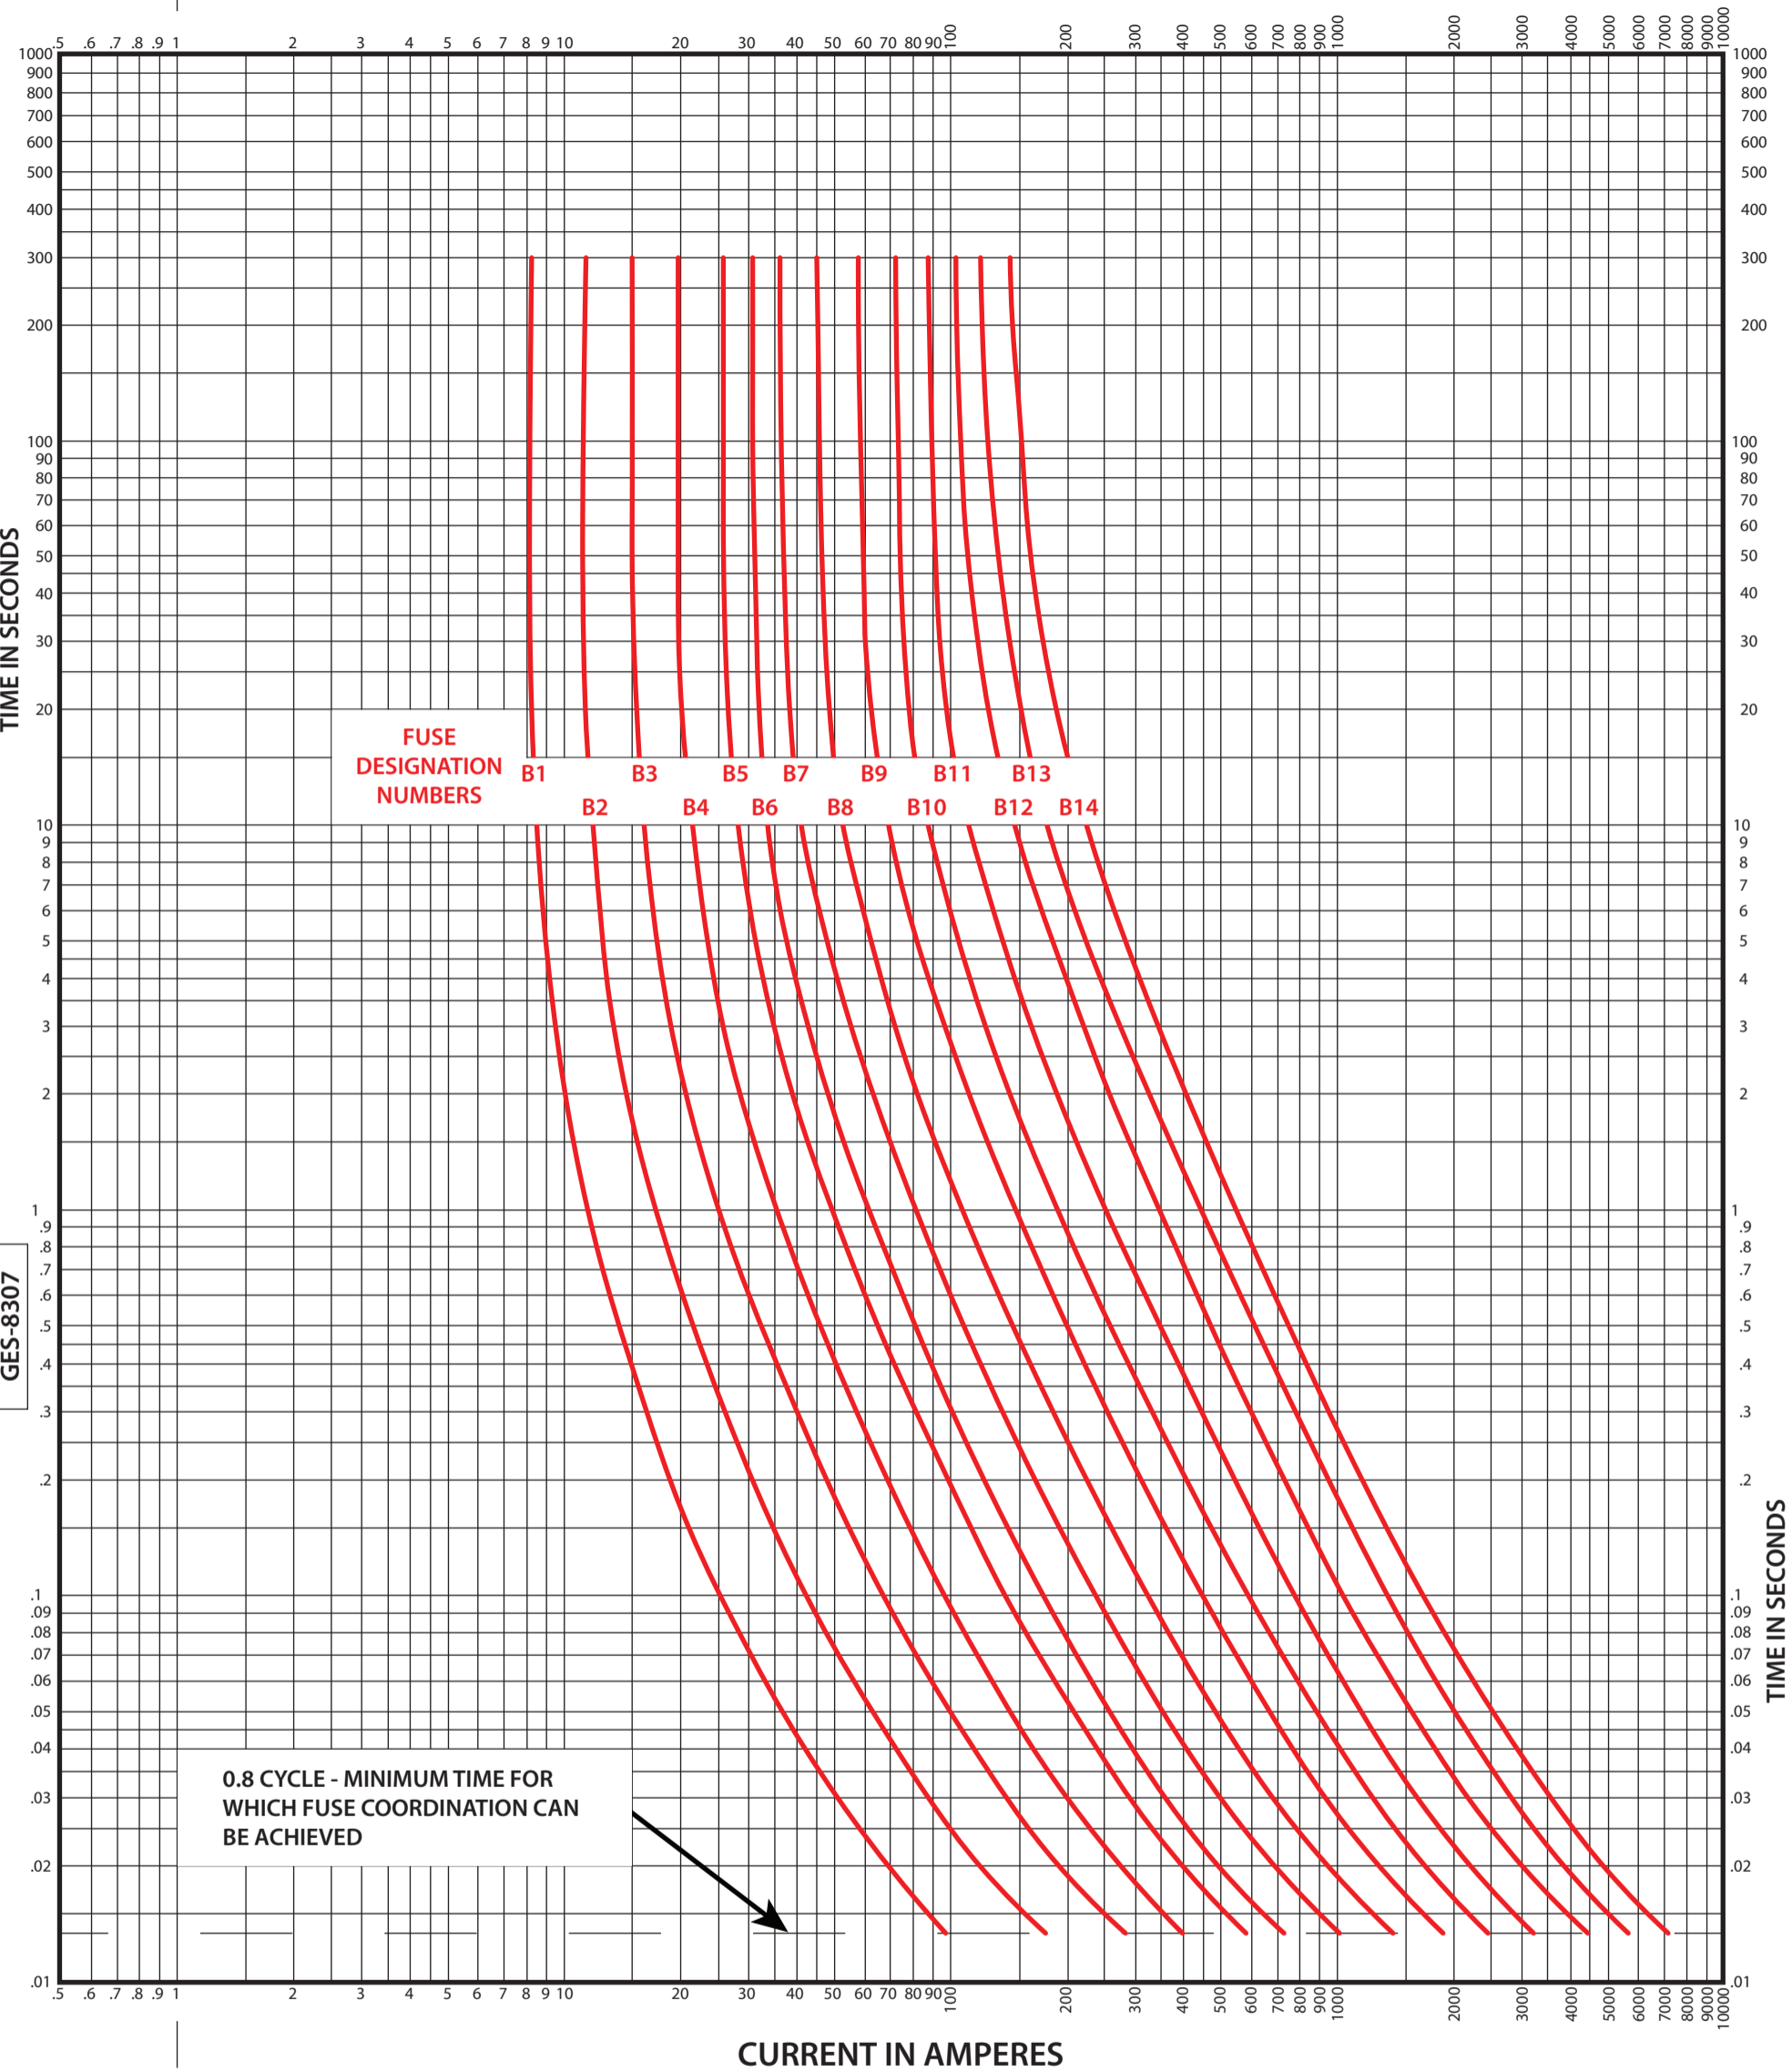

FUSE DESIGNATION NUMBERS
 B1 B2 B3 B4 B5 B6 B7 B8 B9 B10 B11 B12 B13 B14

0.8 CYCLE - MINIMUM TIME FOR WHICH FUSE COORDINATION CAN BE ACHIEVED

CURRENT IN AMPERES



CONNECTION BOARD FUSES
 9F54DB SERIES 8.4 KV MAX
 9F54EB SERIES 8.4 KV MAX
 9F54GB SERIES 8.4 KV MAX
 FUSE NUMBERS B1 TO B14
 Maximum Total-clearing Time-current Curves
 (AT 60 HZ AND 25 C AMBIENT WITH NO INITIAL LOAD)

GES-8307

Current ratings are not assigned to distribution transformer internal fuses.