


CURRENT IN AMPERES

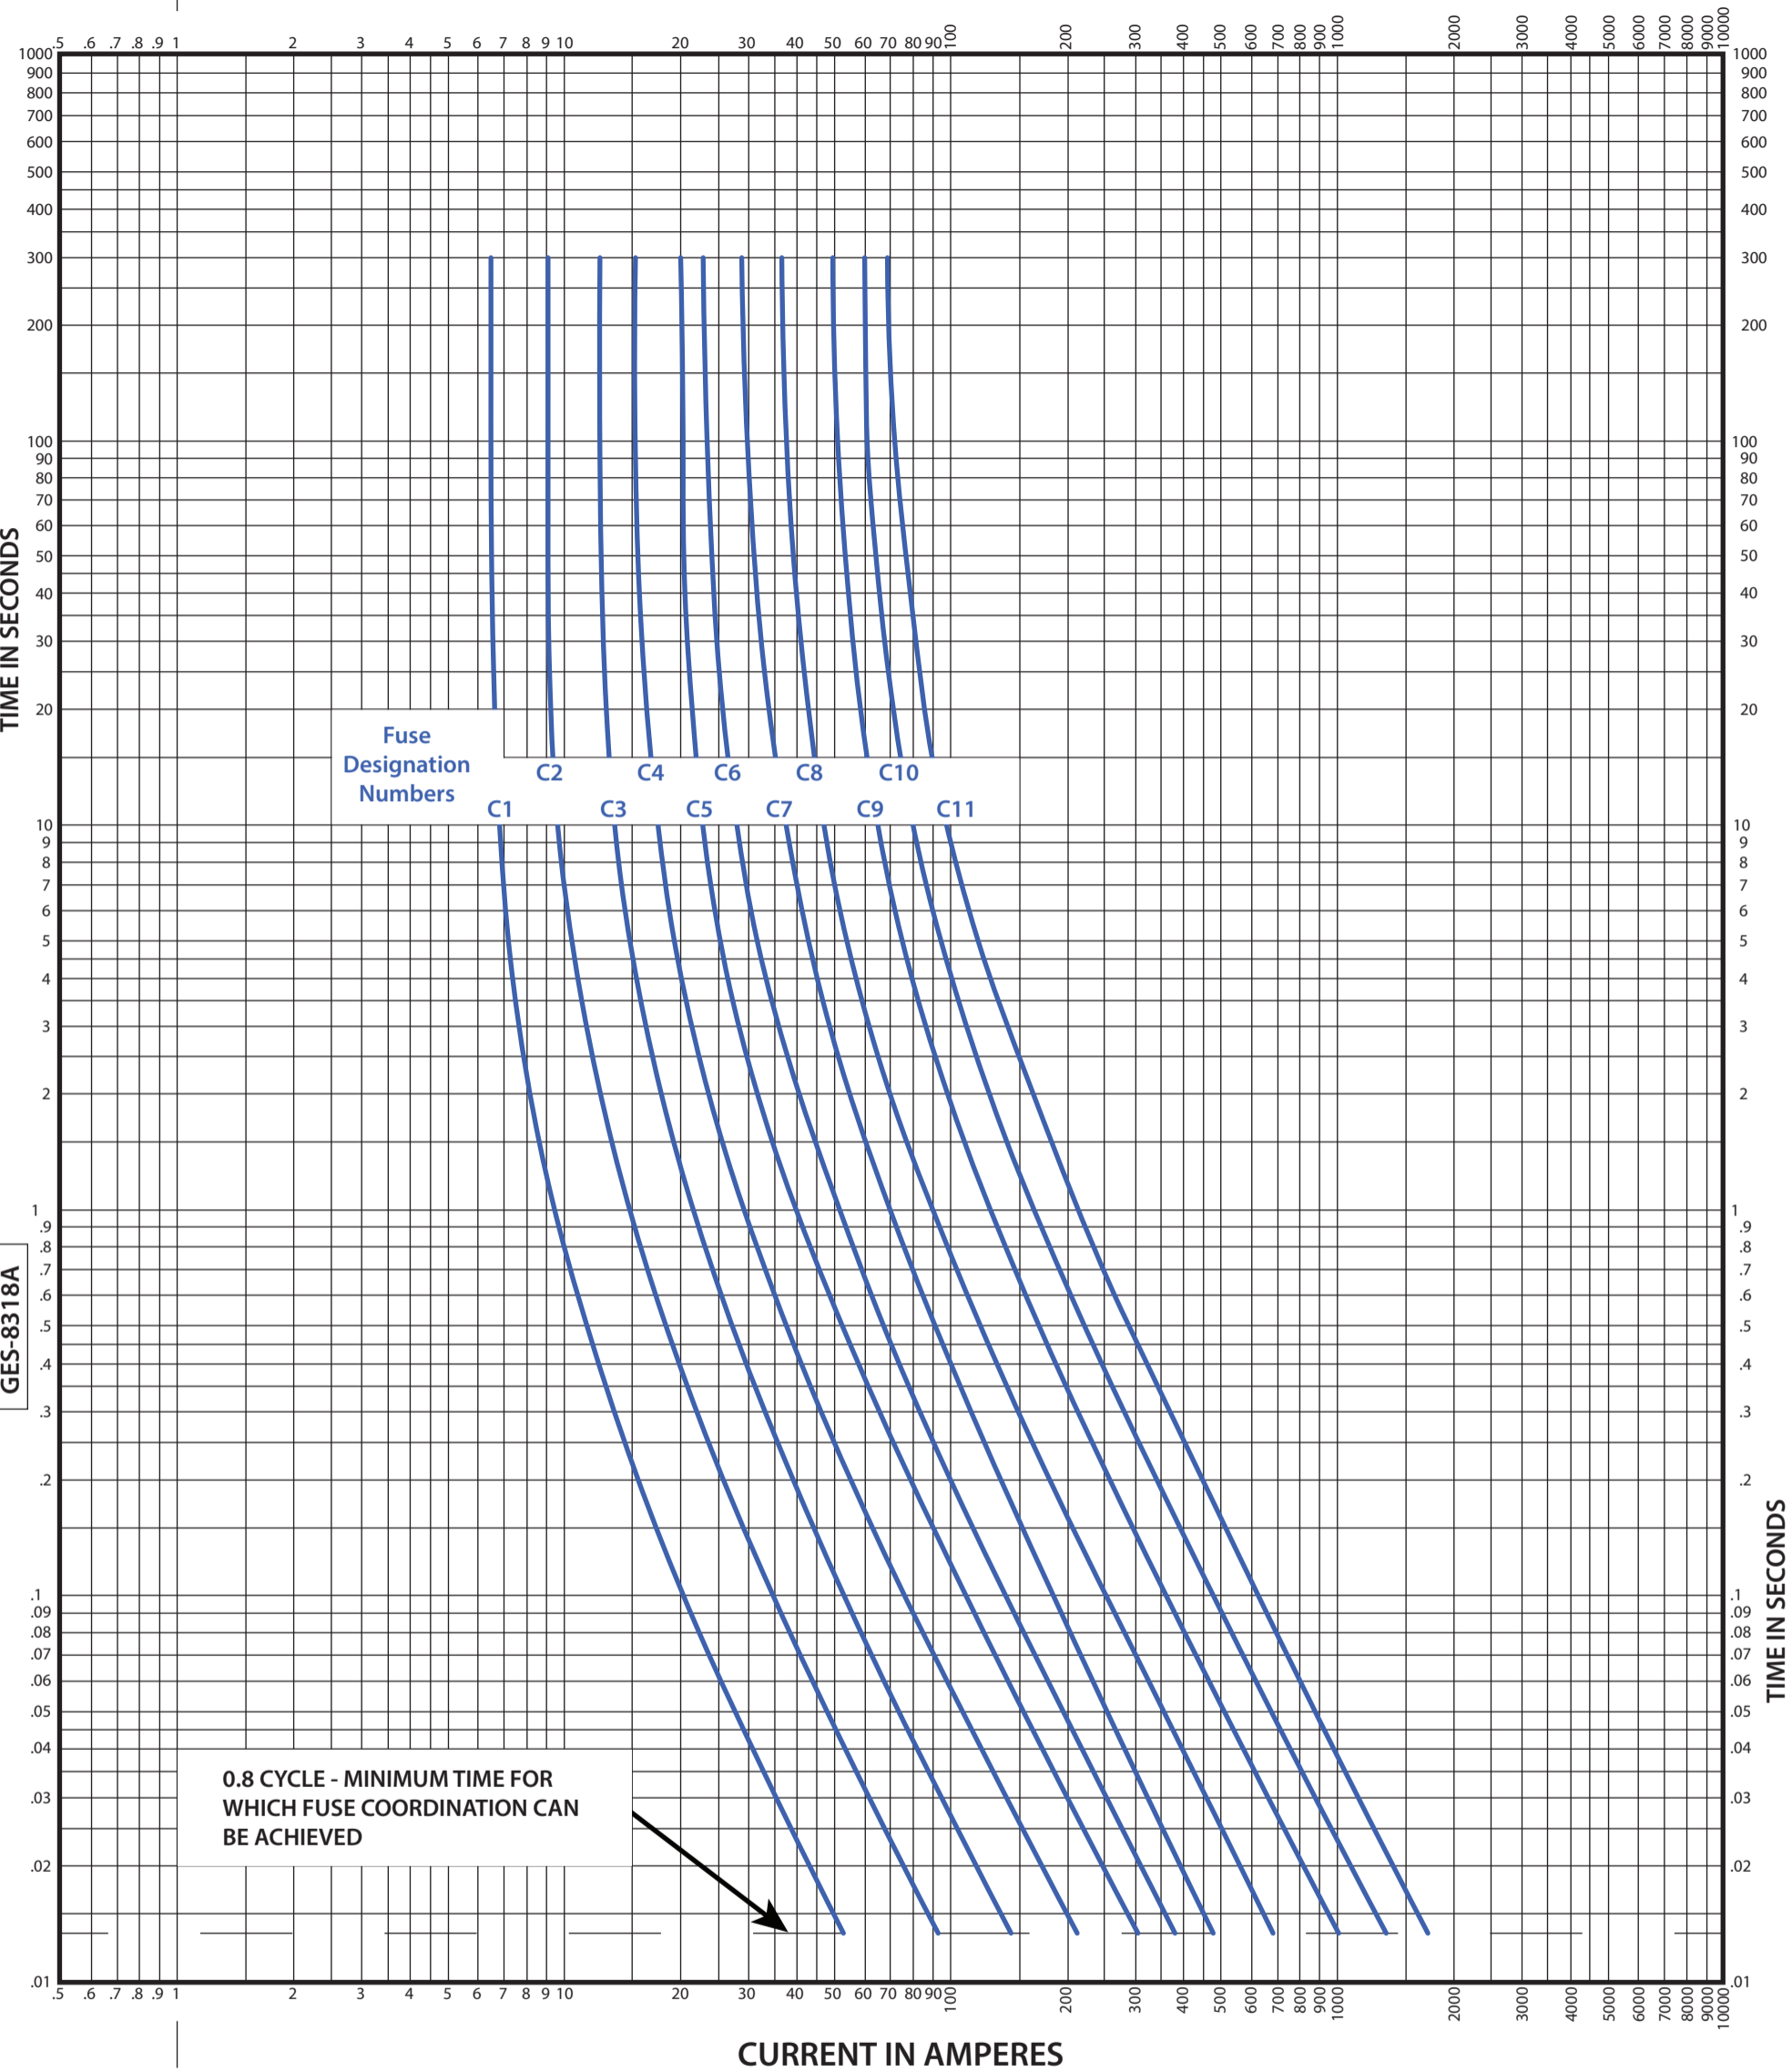

GES-8318A

0.8 CYCLE - MINIMUM TIME FOR WHICH FUSE COORDINATION CAN BE ACHIEVED

CURRENT IN AMPERES



Current ratings are not assigned to distribution transformer internal fuses.

CONNECTION BOARD FUSES
9F54DC SERIES 23 KV MAX
9F54EC SERIES 23 KV MAX
9F54GC SERIES 23 KV MAX
9F54DD SERIES 15 KV MAX
 FUSE NUMBERS C1 TO C11
Minimum-melting Time-current Curves
 (AT 60 HZ AND 25 C AMBIENT WITH NO INITIAL LOAD)

GES-8318A

Fuse 9F954DCA Curves 1 to 9

Fuse 9F54DCB Curves 10 & 11