


CURRENT IN AMPERES

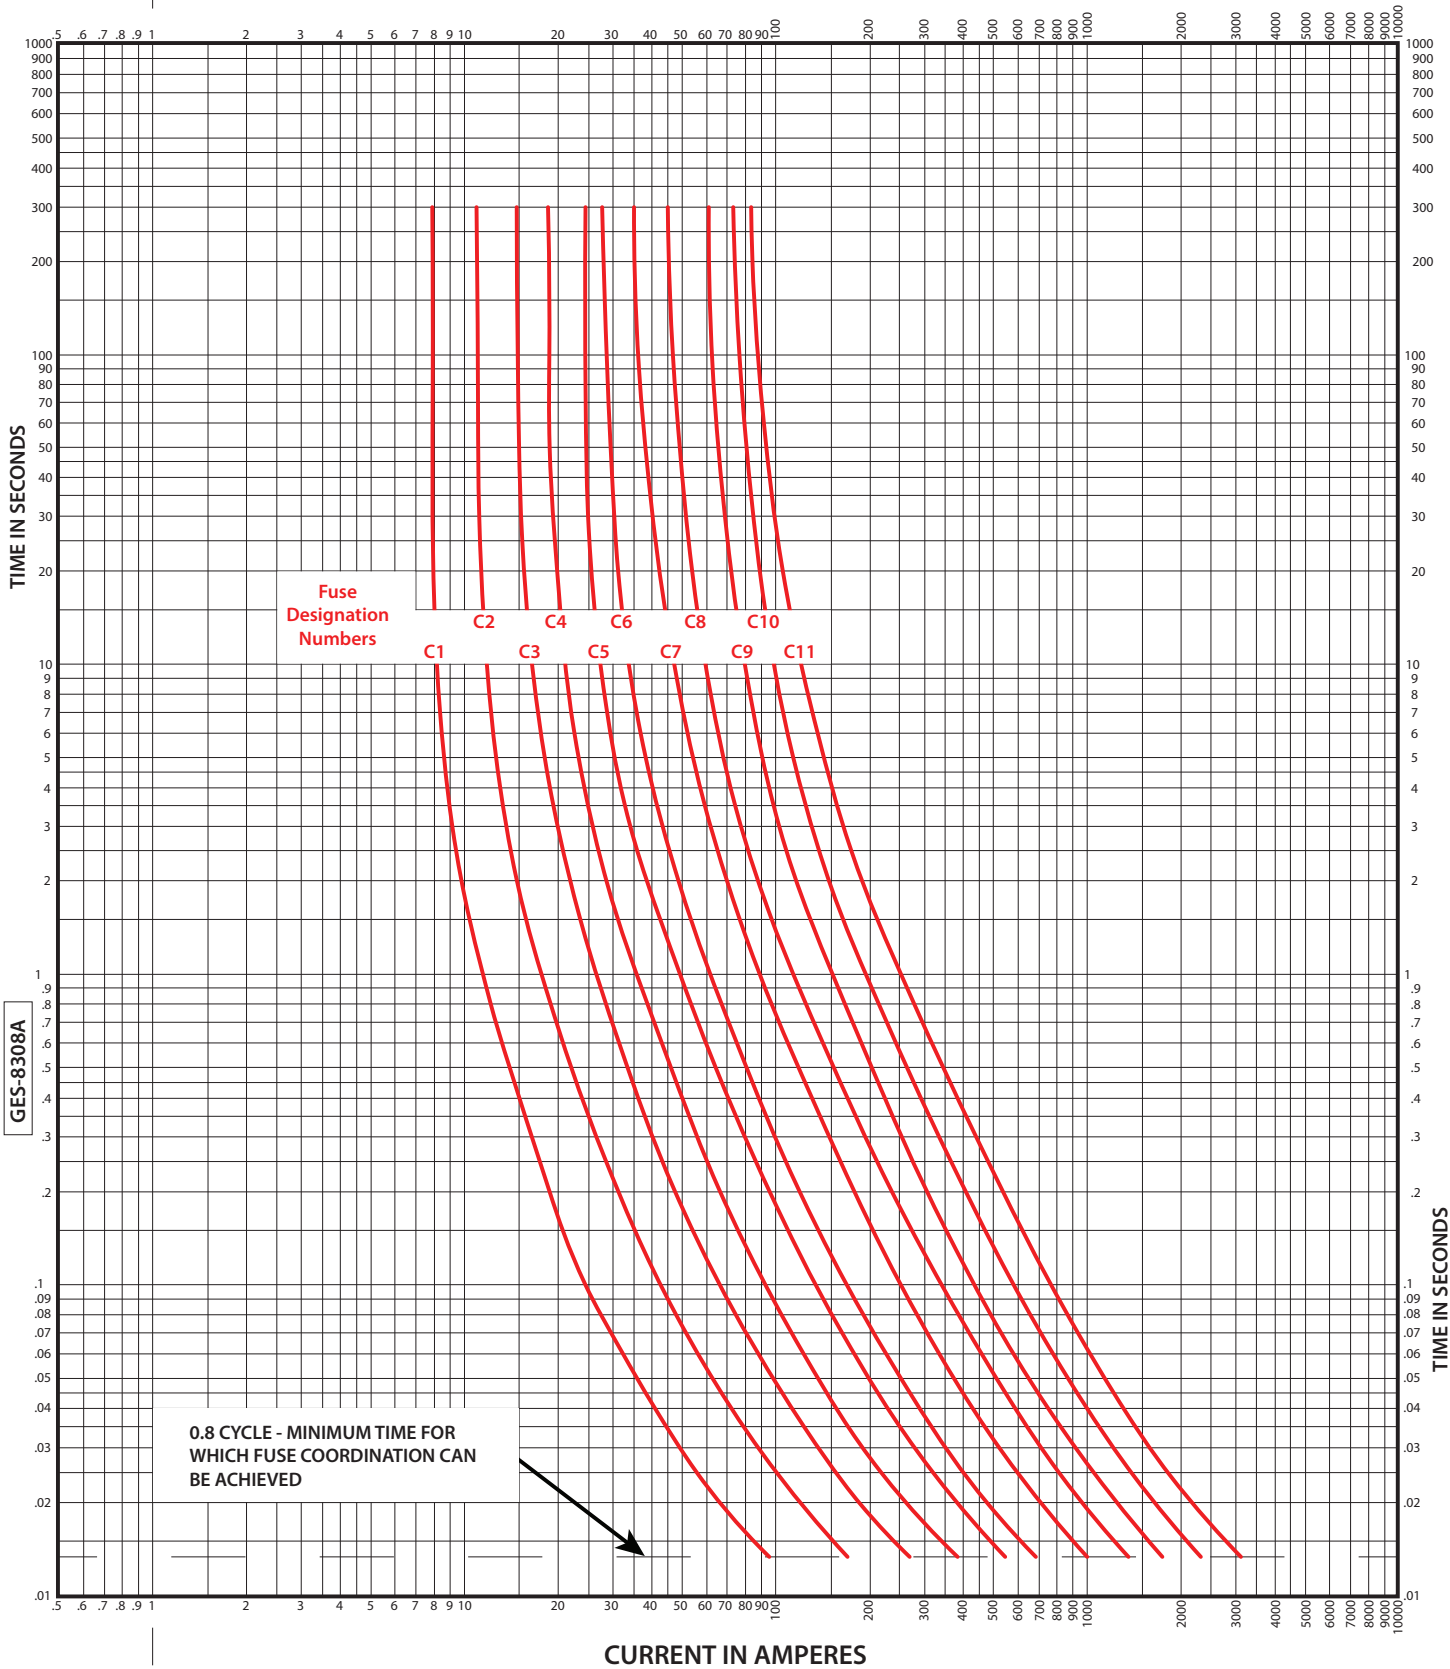

GES-8308A

Fuse Designation Numbers  
 C1 C2 C3 C4 C5 C6 C7 C8 C9 C10 C11

0.8 CYCLE - MINIMUM TIME FOR WHICH FUSE COORDINATION CAN BE ACHIEVED

CURRENT IN AMPERES



CONNECTION BOARD FUSES  
 9F54DC SERIES 23 KV MAX  
 9F54EC SERIES 23 KV MAX  
 9F54GC SERIES 23 KV MAX  
 9F54DD SERIES 15 KV MAX  
 9F54GD SERIES 15 KV MAX  
 FUSE NUMBERS C1 TO C11  
 Maximum Total-clearing Time-current Curves  
 (AT 60 HZ AND 25 C AMBIENT WITH NO INITIAL LOAD)

**GES-8308A**  
 Fuse 9F954DCA Curves 1 to 9  
 Fuse 9F54DCB Curves 10 & 11

Current ratings are not assigned to distribution transformer internal fuses.